

(1) WALLS:- INSULATION IN CAVITY

Ground Floor - Insulation below slab
(Dense blockwork)

UI - CTPIR - 1.02a - Rev 3 - Wall-Floor

THERMAL PERFORMANCE

CHECKLIST
(TICK ALL)

ENSURE CAVITYTHERM CT/PIR IS SECURED FIRMLY AGAINST INNER LEAF OF CAVITY WALL

☐

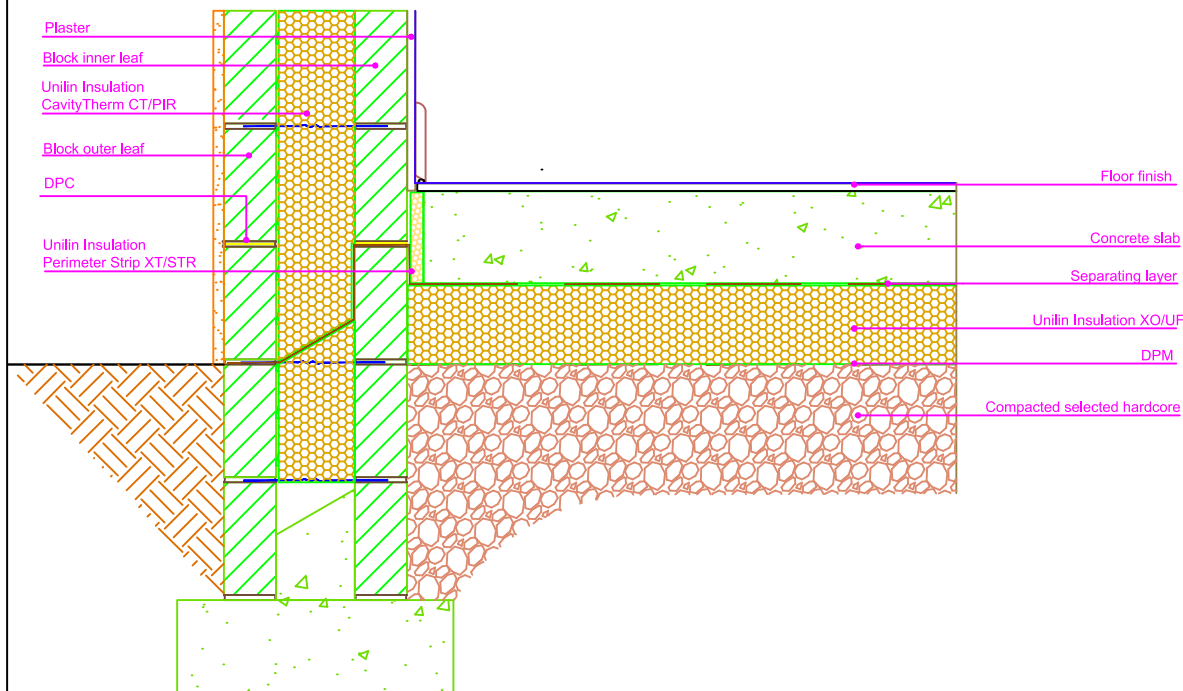
XO/UF FLOOR INSULATION TO TIGHTLY ABUT XT/STR (PERIMETER STRIP)

☐

ENSURE CAVITYTHERM CT/PIR IS INSTALLED AT LEAST 225mm BELOW TOP OF XO/UF

☐

ENSURE 25MM XT/STR WITH A MINIMUM R VALUE OF 1.13 m2 K/W (PERIMETER STRIP) TIGHTLY ABUTS BLOCKWORK WALL

☐

Drawings are for illustration purpose only - not to scale
Details are based on the acceptable construction details
Refer to S.R. 325 for further guidance on detailing

AIR BARRIER - CONTINUITY

CHECKLIST
(TICK ALL)

SEAL BETWEEN WALL AND FLOOR AIR BARRIER WITH A FLEXIBLE SEALANT

☐

OR
SEAL GAP BETWEEN SKIRTING BOARD AND FLOOR WITH FLEXIBLE SEALANT

SEAL ALL PENETRATIONS THROUGH AIR BARRIER USING A FLEXIBLE SEALANT

☐

SEE ACD 1.02a FOR AIR BARRIER OPTIONS

☐

Copyright © 2026, Unilin Insulation,
All rights reserved

GENERAL NOTES

Keep cavities clean of mortar snots and other debris during construction

Detail applicable:- Ground-bearing floor, raft foundation, in-situ suspended ground floor slab, pre-cast suspended ground floor. XO/UF below slab

The wall floor junction is calculated in accordance with the guidance in BR 497 Second Edition section 2.2.2 and 4.7



CERT No: IAB/TM/01

Thermal Modelers Scheme

CavityTherm CT/PIR mm	110	125	150
Psi Value ψ (W/mK)	0.177	0.175	0.173
Temperature Factor (f)	0.83	0.84	0.85
U-Value Wall (W/m ² K)	0.18	0.16	0.13
U-Value Floor (W/m ² K)	0.11 - 0.17		

Email: tech.ui@unilin.com
Phone No: 046 9066050

To be read in conjunction with the Acceptable Construction Details
Any changes to the above construction may change the calculated values
The U values indicated on this certificate are the actual U values for the proposed construction.
The Psi values are calculated using the modelled U value in accordance with the guidelines set out in BR497 and ISO 10211. Contact Unilin Insulation technical support for further guidance