

(1) WALLS:- INSULATION IN CAVITY

Ground Floor - Insulation below slab
(Dense blockwork)

UI - CTPIR - 1.02b - Rev 1 - Wall-Floor

THERMAL PERFORMANCE

CHECKLIST
(TICK ALL)


ENSURE CAVITYTHERM CT/PIR IS SECURED FIRMLY AGAINST INNER LEAF OF CAVITY WALL

HYFLOOR FLOOR INSULATION TO TIGHTLY ABUT XT/STR (PERIMETER STRIP)

ENSURE CAVITYTHERM CT/PIR IS INSTALLED AT LEAST 225mm BELOW TOP OF HYFLOOR

ENSURE 25MM XT/STR WITH A MINIMUM R VALUE OF 1.13 m² K/W (PERIMETER STRIP) TIGHTLY ABUTS BLOCKWORK WALL

ENSURE BLOCK WITH MAX THERMAL CONDUCTIVITY OF 0.2 W/mK IN THE DIRECTION OF HEAT FLOW ARE USED. ENSURE THE BLOCK IS SUITABLE FOR USE IN FOUNDATIONS IN ALL CONDITIONS. ENSURE BLOCK ARE INSTALLED AS PER MANUFACTURERS RECOMMENDATIONS REGARDING POSITION OF DPC ETC. TO AVOID ANY EFFECT OF MOISTURE ON THERMAL CONDUCTIVITY OF THE BLOCK

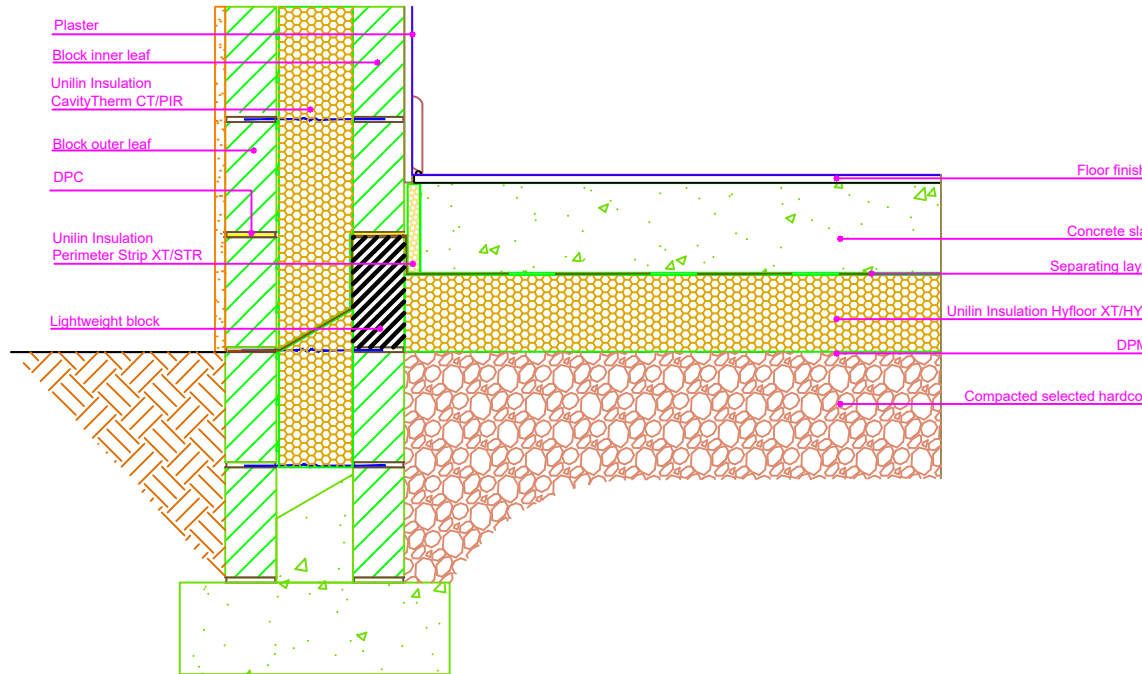

Drawings are for illustration purpose only - not to scale
Details are based on the acceptable construction details
Refer to S.R. 325 for further guidance on detailing

AIR BARRIER - CONTINUITY

CHECKLIST
(TICK ALL)

SEAL BETWEEN WALL AND FLOOR AIR BARRIER WITH A FLEXIBLE SEALANT
OR
SEAL GAP BETWEEN SKIRTING BOARD AND FLOOR WITH FLEXIBLE SEALANT

SEAL ALL PENETRATIONS THROUGH AIR BARRIER USING A FLEXIBLE SEALANT

SEE ACD 1.02b FOR AIR BARRIER OPTIONS

Copyright © *2023, Unilin Insulation, All rights reserved

GENERAL NOTES

Keep cavities clean of mortar snots and other debris during construction

Detail applicable:- Ground-bearing floor, raft foundation, in-situ suspended ground floor slab, pre-cast suspended ground floor. Hyffloor below slab

Where blocks with a maximum Thermal Conductivity of 0.2 W/mK are being used consideration should be give to avoid cracking in plaster due to drying of mortar

The wall floor junction is calculated in accordance with the guidance in BR 497 Second Edition section 2.2.2 and 4.7

Email: info.ui@unilin.com
Phone No: 046 9066050



CERT No: IAB/TM/01
Thermal Modelers Scheme

CavityTherm CT/PIR mm	110	125	150
Psi Value ψ (W/mK)	0.087	0.085	0.083
Temperature Factor (<i>f</i>)	0.90	0.90	0.91
U-Value Wall (W/m ² K)	0.18	0.16	0.13
U-Value Floor (W/m ² K)	0.11 - 0.17		

To be read in conjunction with the Acceptable Construction Details
Any changes to the above construction may change the calculated values
The U values indicated on this certificate are the actual U values for the proposed construction.
The Psi values are calculated using the modelled U value in accordance with the guidelines set out in BR497 and ISO 10211. Contact Unilin Insulation technical support for further guidance