

THERMAL PERFORMANCE

CHECKLIST
(TICK ALL)


- ENSURE CONTINUITY OF INSULATION THROUGHOUT JUNCTION
- ENSURE FULL DEPTH OF MINERAL WOOL BETWEEN AND OVER JOISTS ABUTS MINERAL WOOL EAVES INSULATION
- ENSURE CAVITY THERM CT/PIR IS SECURED FIRMLY AGAINST INNER LEAF OF CAVITY WALL.
- ENSURE GAP BETWEEN THE WALL PLATE AND THE PROPRIETARY EAVES VENT IS COMPLETELY FILLED WITH INSULATION HAVING A MINIMUM R-VALUE ACROSS THE INSULATION OF 3.00 M² K/W



AIR BARRIER - CONTINUITY

CHECKLIST
(TICK ALL)

- BED WALL PLATE ON CONTINUOUS MORTAR
- FIX CEILING FIRST, AND SEAL ALL GAPS BETWEEN CEILING AND MASONRY WALL WITH EITHER PLASTER, ADHESIVE OR FLEXIBLE SEALANT
- SEAL ALL PENETRATIONS THROUGH AIR BARRIER USING A FLEXIBLE SEALANT

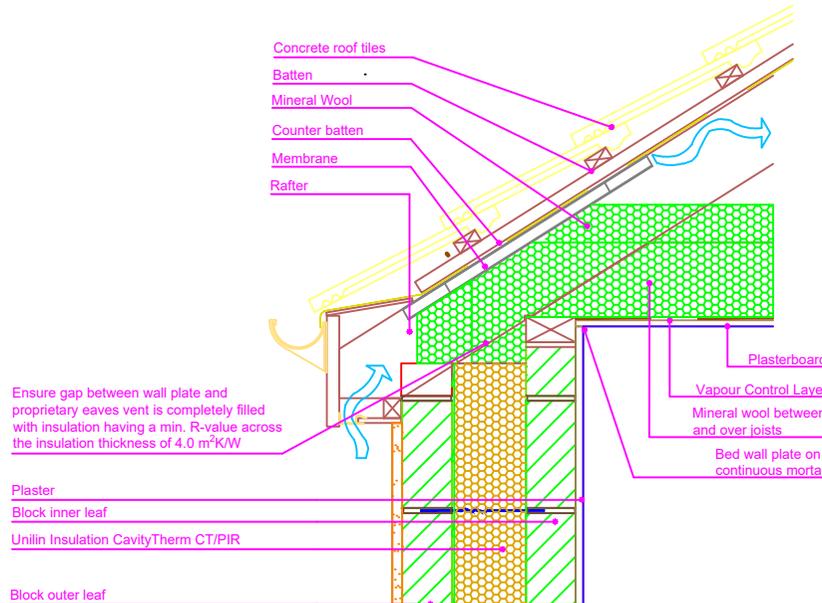

Drawings are for illustration purpose only - not to scale
Details are based on the acceptable construction details
Refer to S.R. 325 for further guidance on detailing

Copyright © *2023, Unilin Insulation,
All rights reserved

GENERAL NOTES

Keep cavities clean of mortar snots and other debris during construction
Use of Mineral Wool between and over joists is considered best practice, as it eliminates the cold bridge caused by the joist.
Use a proprietary eaves ventilator to ensure ventilation in accordance with BS5250.
Installation of the eaves ventilator must not prevent free water drainage below the tiling battens



CERT No: IAB/TM/01

Thermal Modelers Scheme

CavityTherm CT/PIR mm	110	125	150
Psi Value ψ (W/mK)	0.057	0.059	0.061
Temperature Factor (f)	0.94	0.94	0.94
U-Value Wall (W/m ² K)	0.18	0.16	0.13
U-Value Roof (W/m ² K)	0.11 - 0.16		

To be read in conjunction with the Acceptable Construction Details
Any changes to the above construction may change the calculated values
The U values indicated on this certificate are the actual U values for the proposed construction.
The Psi values are calculated using the modelled U value in accordance with the guidelines set out in BR497 and ISO 10211. Contact Unilin Insulation technical support for further guidance

Email: info.ui@unilin.com
Phone No: 046 9066050