


THERMAL PERFORMANCE

CHECKLIST
(TICK ALL)

ENSURE CAVITY THERM CT/PIR IS SECURED FIRMLY AGAINST INNER LEAF OF CAVITY WALL

INSTALL PROPRIETARY CAVITY CLOSER WITH A MINIMUM R VALUE OF 4.29 m² KW - UNILIN INSULATION CAVITY CLOSE-R MEETS OR EXCEEDS THE MINIMUM REQUIREMENT

ENSURE ALL GAPS AROUND AND BETWEEN LINTEL ARE TIGHTLY PACKED WITH INSULATION

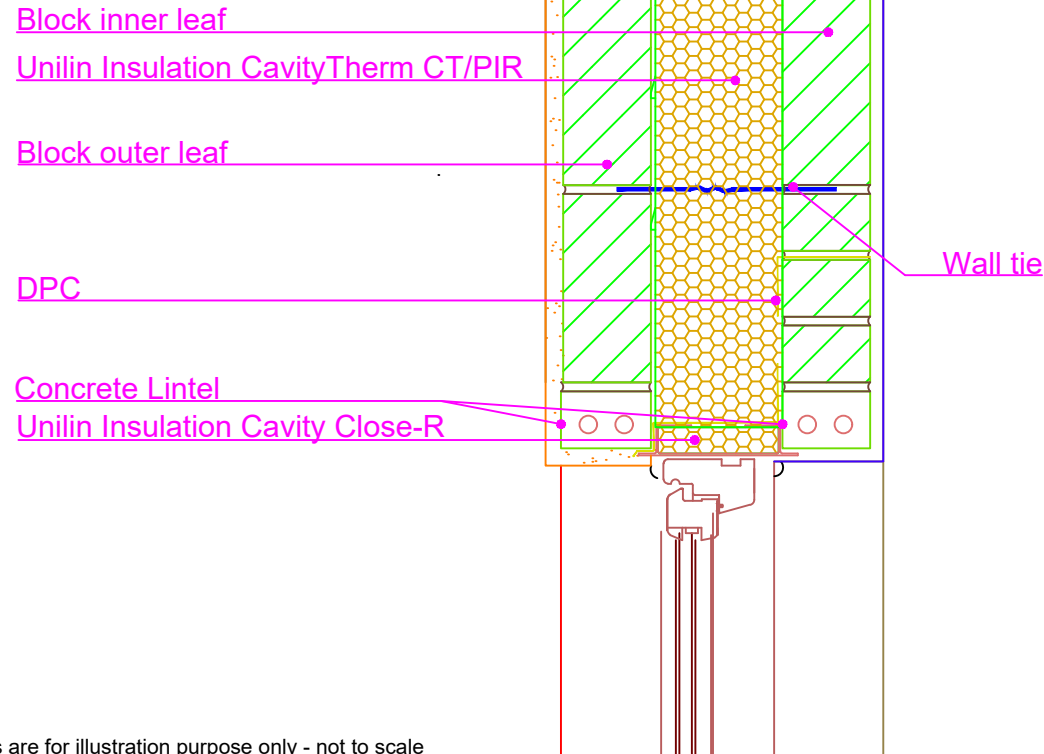

Drawings are for illustration purpose only - not to scale
Details are based on the acceptable construction details
Refer to S.R. 325 for further guidance on detailing

AIR BARRIER - CONTINUITY

CHECKLIST
(TICK ALL)

SEAL ALL PENETRATIONS THROUGH AIR BARRIER USING A FLEXIBLE SEALANT

IF FORMING THE AIR BARRIER TO THE WALLS WITH A BLOCKWORK INNER LEAF OR A SCRATCH COAT ON BLOCKS, INSTALL A FLEXIBLE SEALANT BETWEEN CAVITY CLOSER AND BLOCKWORK WALL

APPLY FLEXIBLE SEALANT TO ALL INTERFACES BETWEEN INTERNAL AIR BARRIER AND WINDOW/DOOR FRAME MEMBERS

SEE ACD 1.23.2 FOR AIR BARRIER OPTIONS

Copyright © *2023, Unilin Insulation, All rights reserved

GENERAL NOTES

Keep cavities clean of mortar snots and other debris during construction



CERT No: IAB/TM/01
Thermal Modelers Scheme

CavityTherm CT/PIR mm	110	125	150
Psi Value ψ (W/mK)	0.002	0.001	0.001
Temperature Factor (<i>f</i>)	0.98	0.98	0.98
U-Value Wall (W/m ² K)	0.18	0.16	0.13

To be read in conjunction with the Acceptable Construction Details
Any changes to the above construction may change the calculated values
The U values indicated on this certificate are the actual U values for the proposed construction.
The Psi values are calculated using the modelled U value in accordance with the guidelines set out in BR497 and ISO 10211. Contact Unilin Insulation technical support for further guidance

Email: info.ui@unilin.com
Phone No: 046 9066050